

Partial Discharge Report


Report Name
Date and Time 2025-10-13 14:59:29
Site Name
Site Location
Performed By
Phone
Email



HIKMICRO
See the World in a New Way

Statistics

Total Images	1
Corona	1

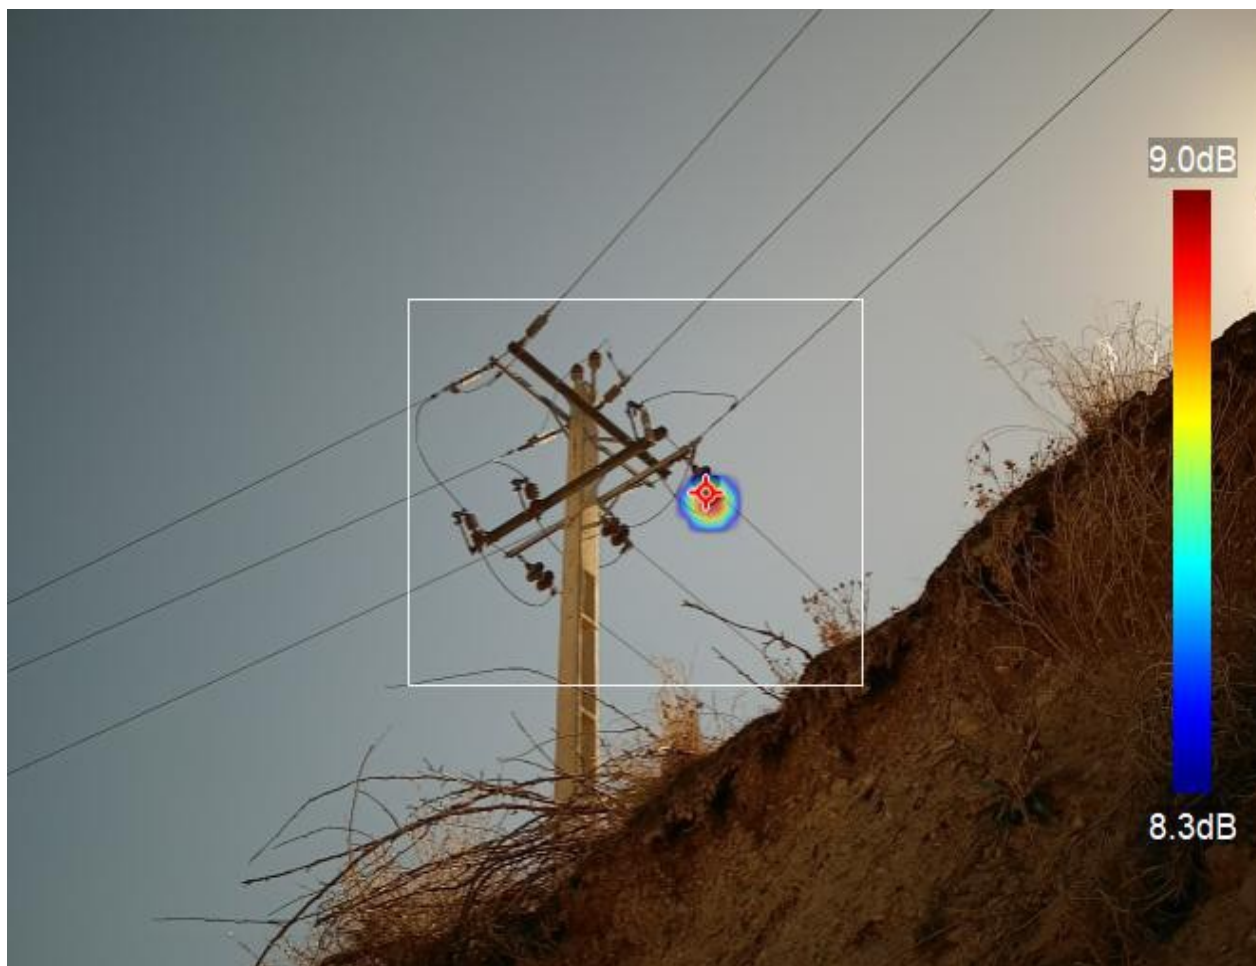

Partial Discharge Info

Max. Level	9.0 dB
Discharge Level	Severe
Selected Frequency	19.9 ~ 49.9 kHz
Range	
Distance	16.0 m


Discharge Type

Corona	99%
Particle	0%
Surface	0%
Floating	0%


Image Information

Created	2025-10-12 12:43:55
File Name	HM20251012124355.pd
Device Model	AI76
Device Serial No.	EA2404668


PRPD

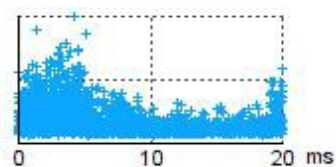

Signal

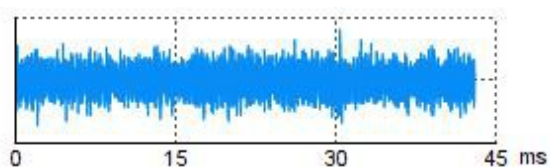

FFT

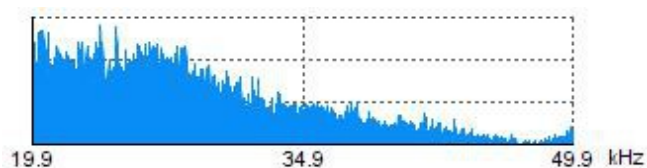

Text Note